

**SLIP RESISTANCE  
TEST REPORT**



Project : Slip Resistance Investigation  
 Location of Test : Auckland Laboratory  
 Client : Nauhria Precast Ltd  
 Slider type : FOUR-S, Prepared on P 400 (or equivalent) sand paper & Wet Lapping film.  
 Specimen Description : Diamond Honed Monarc Oyster 0010 Concrete Pavers 300x300mm

Cleaning Procedure : Wet Brush  
 Test Type : Unfixed  
 Air Temp at Test (°C) : 18

Project Number : 1-LA394.00  
 Lab Ref. Number : AL2861/1  
 Client Ref. Number : -


SLIP RESISTANCE TEST RESULTS			
Test № :	Test Direction :	Mean BPN :	Mean Coefficient of Friction* :
1	N/A	45	0.47
2		43	0.45
3		41	0.43
4		44	0.46
5		42	0.44
Average (SRV) :		43	0.45
Classification of pedestrian surface material in accordance with table 2, AS 4586:2013 :			P3

**TEST METHOD**

Tests were carried out in accordance with Appendix A, AS 4586:2013, the classification is based on a test in the wet condition.

\*Coefficient of friction obtained from: AS/NZS 3661.1 : 1993 Slip Resistance of Pedestrian Surfaces.

**SAMPLE TESTED**

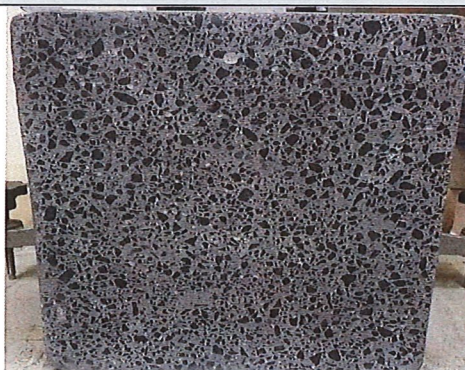

Tested By : OPUS - G. Sandford  
 Designation : Civil Engineering Technician  
 Date Tested : 13/07/18

LAF026 (08/17)

Page 1 of 1